


## Hospital Industrial Compressed Air System – ACIH, series 1 10 Bar / 208V – 480V / 50Hz – 60Hz SIMPLEX

### Technical Specification

#### ACIH Hospital Industrial Air

The Hospital Industrial Compressed Air shall conform to the European Machine Directive and ACSS 08/2010 Health Technical Memorandum. Clean compressed air according to PNEUROPS Standards shall be delivered at a pressure of 800 kPa (8 bar) gauge for supply of the hospital industrial applications, including autoclave, laundry machines, medical instruments drying systems and all non-medicated pneumatic devices. The compressor will be capable of supplying 100% of the specified volumetric flow.

#### Typical SIMPLEX Layout

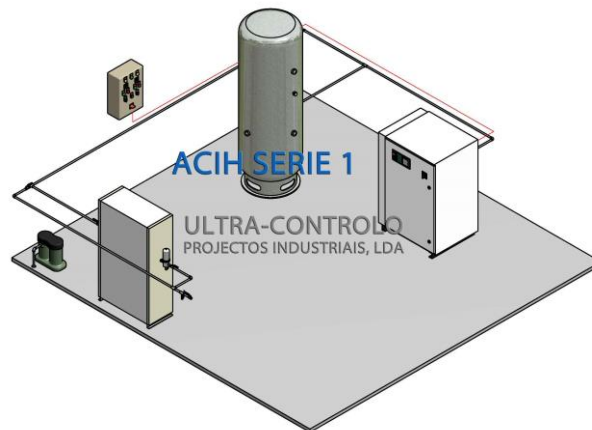

#### Compressors

Compressors shall be oil injected rotary screw compressors suitable for both continuous and frequent start/stop operation at a nominal outlet pressure of 950 kPa gauge (9.5 bar). The compressor should have a heat exchanger air / air and oil / air-aluminum finned heat sinks with fans and large output and to maximize cooling and efficiency. The compressor must be equipped with an oil separation system capable of maintaining a residual amount of oil on the exhaust approx. 2 ppm to minimize contamination and network maintenance. The compressor unit should be equipped with electric motor high efficiency and comply with EN 60034-30, must be rated TEFC, IP55 class F electric shall be used and incorporate maintenance-free greased for life bearings. The interface for command and control of the compressor will have a microprocessor with a smart touch panel and language, must provide information alerts and warnings in written format, including the operating pressure, internal temperature and air temperature at the compressor outlet, number of load hours and total hours of operation and early warning of preventive maintenance. Each compressor shall be provided with a cyclone separator discharge, including electronic condensate drain valve with timer command.

#### Air Treatment Unit

An air treatment unit should be able to process all the air needed to supply the hospitals with air quality for industrial instrumentation. The filtration system should include a mist separator pre-filter for elimination of all solid and liquid particles larger than 0.1 micron and oil aerosols present in the air. A refrigeration dryer with a dew point of +3 ° C and a sub-mist separator for disposal of all solid and liquid particles with dimensions down to 0.01 micron filter. Both filters will auto drains and differential pressure gauge indicator of the state of clogging. The treatment unit will include an adsorption dryer for retention of water molecules in molecular mesh with strong physical attraction, consisting of two columns of



Due to the continuous improvement of our products, the right is reserved to change the specification of the items described herein at any time. Please contact us for further information and up to date specifications.

adsorbent material in case of need dry air with a dew point of -20. The unit shall be able to work at temperatures up to 50 ° C and at pressures of from 5 to 16 bar. The quality of the output will be guaranteed the air handling unit must be within the values indicated in the following table:

Contaminant	Threshold
Dew point	3°C/-20°C
Particulates	< 0,01 micron
Oil	0.1 mg/m <sup>3</sup>

### Control System

The regulatory framework should enable the automatic startup of the compressor and the control treatment unit. Must operate at low voltage and include signaling for Central Technical Management, providing alerts and alarms including failure of the central and low pressure alarm. The control system shall have an electro-mechanical device that in case of failure of digital control, to maintain the facility in semi-automatic operation.

### Receiver Assembly

The air receiver must comply with EN 286-1 and be supplied with relevant test certificates. The receiver will have an internal and external treatment for hot-dip galvanizing in order to avoid contamination of the network with ferrous material and will have an epoxy painting, primer and finish, for protection against the environment. The tank will be equipped with safety and calibrated valve with pressure gauge calibrated and relevant certificates. The system should possess additional connections available and free for connecting emergency groups.

### Condensate Separator

The central will have a network of collection of condensate to be treated by oil / water separator to protect the environment and comply with regulations of industrial waste processing and issuance of domestic effluents.

### Basic Configuration of Industrial Air Center Hospital ACIH series 1:

- 1 rotary oil lubricated screw compressor including cyclonic separator
- 1 air treatment and drying unit with pre and post high efficiency filter
- 1 vertical, galvanized tank with their safety accessories
- 1 electrical control panel including signaling for remote management
- 1 oil/water separator for condensate treatment

**Hospital Industrial Compressed Air System - ACIH  
400V 50Hz, 10 Bar Outlet  
SIMPLEX  
Standard Models**

<b>ACIH</b>							
<b>400V 50Hz</b>							
<b>Model</b>	<b>System capacity</b>				<b>Electric motor power</b>		<b>Article Number</b>
	<b>m3/h</b>	<b>l/m</b>	<b>l/s</b>	<b>scfm</b>	<b>Kw</b>	<b>hP</b>	
1.15/500	14	233	3,9	8	2,2	3	305.01.00000
1.20/500	22	360	6	13	3	4	305.01.00001
1.30/500	32	530	8,8	19	4	6	305.01.00002
1.40/500	41	680	11,3	24	5,5	8	305.01.00003
1.60/500	64	1060	17,7	37	7,5	10	305.01.00004
1.100/800	96	1602	26,7	57	11	15	305.01.00005
1.130/1000	136	2260	37,7	80	15	20	305.01.00006
1.170/1500	164	2740	45,7	97	18,5	25	305.01.00007
1.200/2000	193	3210	53,5	113	22	30	305.01.00008
1.300/2000	302	5028	83,8	177	30	40	305.01.00009
1.370/2000	371	6190	103,2	218	37	50	305.01.00010
1.420/2000	421	7020	117	248	45	60	305.01.00011
1.450/2000	445	7420	123,7	262	45	60	305.01.00012
1.600/2000	572	9540	159	337	55	74	305.01.00013
1.750/2000	749	12480	208	440	75	100	305.01.00014

**Hospital Industrial Compressed Air System - ACIH  
380V 60Hz, 10 Bar Outlet  
SIMPLEX  
Standard Models**

<b>ACIH</b>							
<b>380V 60Hz</b>							
<b>Model</b>	<b>System capacity</b>				<b>Electric motor power</b>		<b>Article Number</b>
	<b>m3/h</b>	<b>l/m</b>	<b>l/s</b>	<b>scfm</b>	<b>Kw</b>	<b>hP</b>	
1.15/500	14	233	3,9	8	2,2	3	305.01.00600
1.20/500	22	360	6	13	3	4	305.01.00601
1.30/500	32	530	8,8	19	4	6	305.01.00602
1.40/500	41	680	11,3	24	5,5	8	305.01.00603
1.60/500	64	1060	17,7	37	7,5	10	305.01.00604
1.100/800	96	1602	26,7	57	11	15	305.01.00605
1.130/1000	136	2260	37,7	80	15	20	305.01.00606
1.170/1500	164	2740	45,7	97	18,5	25	305.01.00607
1.200/2000	193	3210	53,5	113	22	30	305.01.00608
1.300/2000	302	5028	83,8	177	30	40	305.01.00609
1.370/2000	371	6190	103,2	218	37	50	305.01.00610
1.420/2000	421	7020	117	248	45	60	305.01.00611
1.450/2000	445	7420	123,7	262	45	60	305.01.00612
1.600/2000	572	9540	159	337	55	74	305.01.00613
1.750/2000	749	12480	208	440	75	100	305.01.00614